


Tank Installation Setbacks

Aboveground Tank

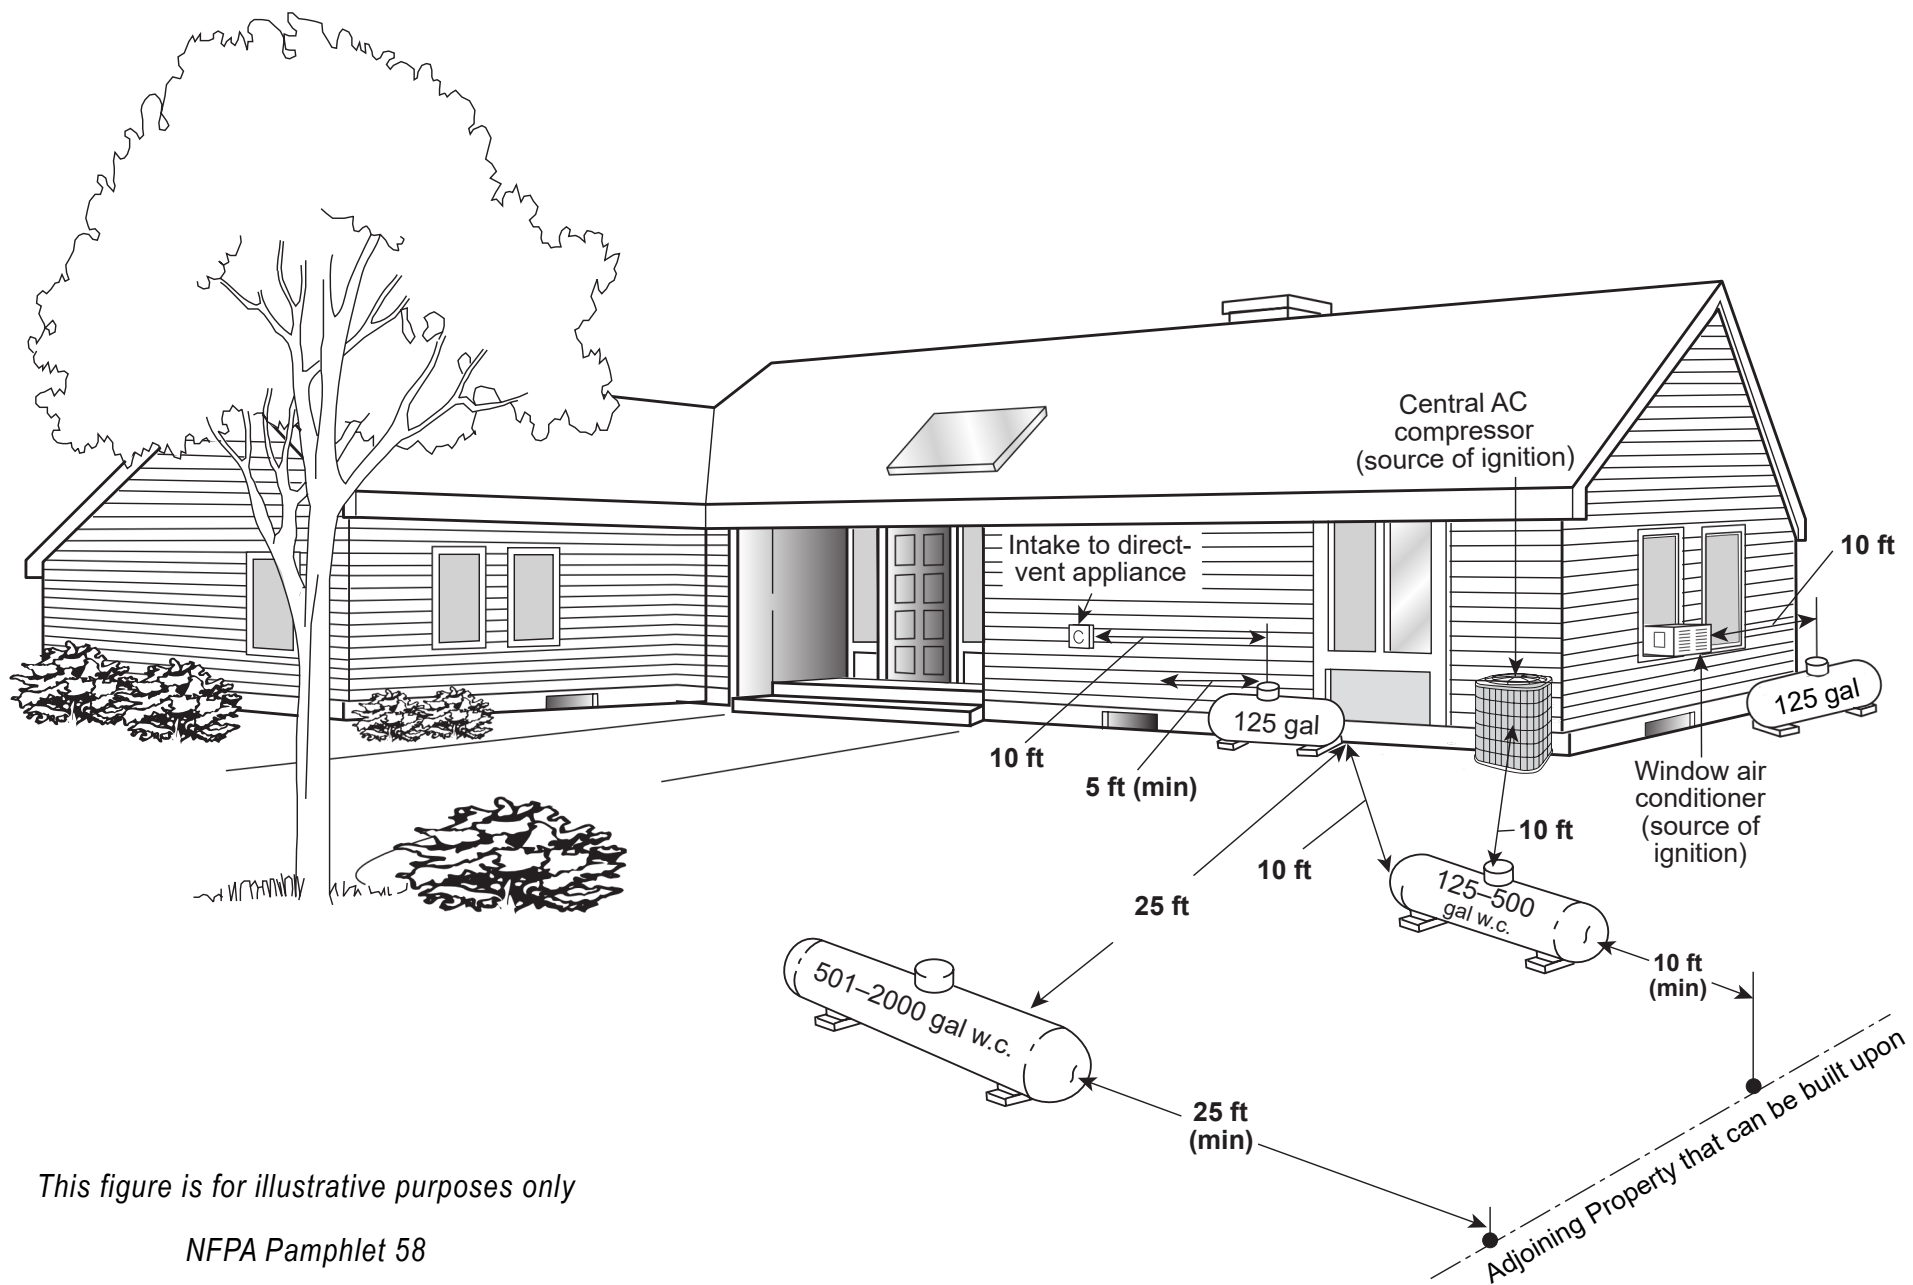

This figure is for illustrative purposes only

NFPA Pamphlet 58

**All tanks must be 10 feet from any external source of ignition.
- Exhaust vent, AC unit, open flame, etc ...**

1. Tank Set Back:

- Tanks with capacity of 120 WC or smaller can sit next to a building.
- Tanks larger than 125 WC must be 10 feet from building.
- Tanks larger than 501wc must be 25 feet from building

2. Gas Line Depth

- Steel pipe must be coated or wrapped and 12 in. deep.
Ditches must be straight.
- Plastic poly pipe must be 18in. deep.

3. Regulator needs to be 5 feet from ignition source.

